





wyposażenie do 3KD wielk. 2 Ścianki separacyjne faz zawiera 6 szt.

Wersja						
Nazwa markowa produktu	SETRON					
oznaczenie produktu	Wyposażenie do rozłącznika izolacyjnego					
wykonanie produktu	Separatory fazowe					
Stosowność						
możliwość zastosowania	do 3KD wielkość 2					
Szczegóły produktu						
opis produktu	zawiera 6 sztuk					
Konstrukcja mechaniczna						
wysokość	79,3 mm					
szerokość	3 mm					
głębokość	48 mm					
Waga netto na jedn.	0,126 kg					
Zezwolenia Certyfikaty						
Environment	General Product Approval					
<a href="#">Environmental Con- firmations</a>	<a href="#">Environmental Con- firmations</a>	<a href="#">Miscellaneous</a>		<a href="#">Confirmation</a>		
General Product Ap- proval	Test Certificates	other		<a href="#">Confirmation</a>		<a href="#">Miscellaneous</a>
	<a href="#">Type Test Certific- ates/Test Report</a>					

### Więcej informacji

Informacje dotyczące opakowania

[Informacje dotyczące opakowania](#)

Information for data generation and storage

<https://support.industry.siemens.com/cs/ww/en/view/109995012>

Information- and Downloadcenter (Catalogs, Brochures,...)

<https://www.siemens.com/lowvoltage/catalogs>

Industry Mall (Online ordering system)

<https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3KD9108-6>

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

<https://support.industry.siemens.com/cs/ww/pl/ps/3KD9108-6>

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, ...)

[https://www.automation.siemens.com/bilddb/cax\\_en.aspx?mlfb=3KD9108-6](https://www.automation.siemens.com/bilddb/cax_en.aspx?mlfb=3KD9108-6)

CAx-Online-Generator


<https://www.siemens.com/cax>

Tender specifications

<https://www.siemens.com/specifications>

Krzywe charakterystyczne

[https://curves.simaris.siemens.com/curves/<mmp\\_prod\\_noCOMP='HAUPT'></mmp\\_prod\\_no>](https://curves.simaris.siemens.com/curves/<mmp_prod_noCOMP='HAUPT'></mmp_prod_no>)

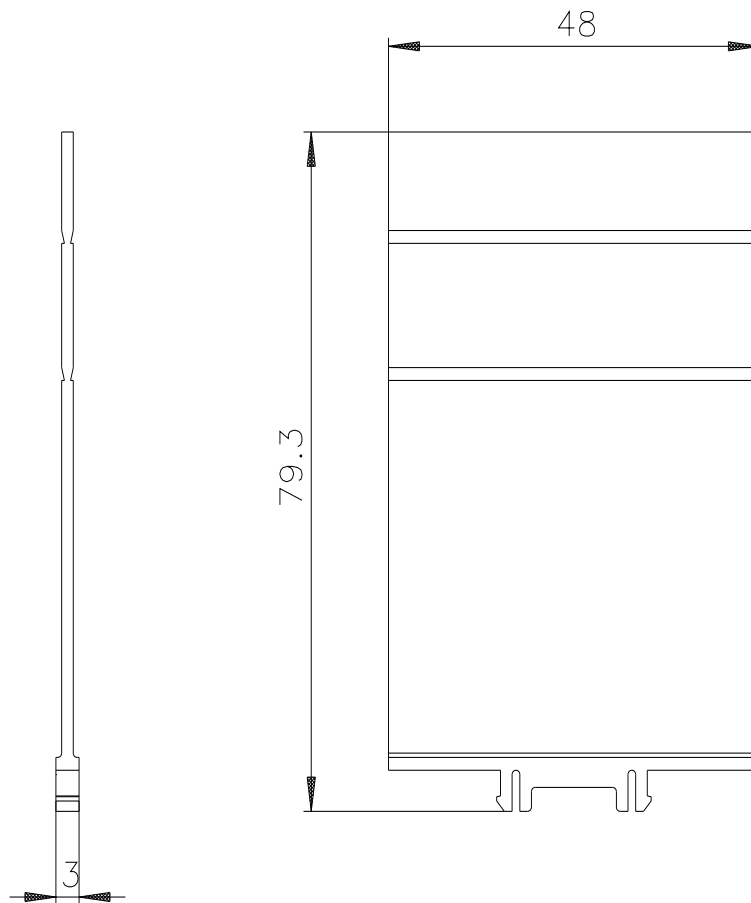

Ostatnia zmiana:

3.04.2025 

